

ETA-Danmark A/S Göteborg Plads 1 DK-2150 Nordhavn Tel. +45 72 24 59 00 Fax +45 72 24 59 04 Internet ww.etadanmark.dk Authorised and notified according to Article 29 of the Regulation (EU) No 305/2011 of the European Parliament and of the Council of 9 March 2011



### European Technical Assessment ETA-19/0642 of 2019/10/08

#### I General Part

Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: ETA-Danmark A/S

Trade name of the construction product:	POLY-GP <sup>®</sup> / POLY-GP <sup>®</sup> PLUS Bonded anchor
Product family to which the above construction product belongs:	Bonded injection type anchor for use in masonry: sizes M6 to M12
Manufacturer:	Simpson Strong-Tie <sup>®</sup> Rue du Camp Z.A.C. des Quatre Chemins F-85400 Sainte Gemme La Plaine Tel. +33 2 51 28 44 00 Fax +33 2 51 28 44 01 Internet www.simpson.fr
Manufacturing plant:	Simpson Strong-Tie <sup>®</sup> Manufacturing Facilities
This European Technical Assessment contains:	22 pages including 17 annexes which form an integral part of the document
This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of: This version replaces:	EAD 330076-00-0604, Metal injection anchors for use in masonry

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (except the confidential Annexes referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

#### II SPECIFIC PART OF THE EUROPEAN TECHNICAL ASSESSMENT

### 1 Technical description of product and intended use

#### Technical description of the product

The POLY-GP<sup>®</sup> / POLY-GP<sup>®</sup> PLUS is a bonded anchor (injection type) for use in masonry consisting of a cartridge with POLY-GP<sup>®</sup> / POLY-GP<sup>®</sup> PLUS injection mortar a perforated nylon sleeve, and an anchor rod with hexagon nut and washer in the range of M6, M8, M10 and M12.

The product specification is given in annex A.

The steel element is placed into a drilled hole / perforated sleeve filled with injection mortar and is anchored via bond and/or mechanical interlock between metal part, injection mortar and masonry.

The characteristic material values, dimensions and tolerances of the anchors not indicated in Annexes shall correspond to the respective values laid down in the technical documentation<sup>1</sup> of this European Technical Assessment.

### 2 Specification of the intended use in accordance with the applicable EAD

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed intended working life of the anchor of 50 years.

The indications given on the working life cannot be interpreted as a guarantee given by the producer or Assessment Body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

<sup>1</sup> The technical documentation of this European Technical Assessment is deposited at ETA-Danmark and, as far as relevant for the tasks of the Notified bodies involved in the attestation of conformity procedure, is handed over to the notified bodies.

## **3** Performance of the product and references to the methods used for its assessment

#### **3.1** Characteristics of product

#### Mechanical resistance and stability (BWR 1):

The essential characteristics are detailed in the Annex C.

#### Safety in case of fire (BWR 2):

The essential characteristics are detailed in the Annex C.

#### Hygiene, health and the environment (BWR3):

No performance assessed

#### Safety in use (BWR4):

For basic requirement Safety in use the same criteria are valid for Basic Requirement Mechanical resistance and stability (BWR1).

#### Sustainable use of natural resources (BWR7)

No performance determined

Other Basic Requirements are not relevant.

#### 3.2 Methods of assessment

The assessment of fitness of the anchor for the intended use in relation to the requirements for mechanical resistance and stability and safety in use in the sense of the Basic Requirements 1 and 4 has been made in accordance with EAD 330076-00-0604, Metal injection anchors for use in masonry.

## 4 Assessment and verification of constancy of performance (AVCP)

#### 4.1 AVCP system


According to the decision 1997/177/EC of the European Commission, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) is 1.


# 5 Technical details necessary for the implementation of the AVCP system, as foreseen in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at ETA-Danmark prior to CE marking.

Issued in Copenhagen on 2019-10-08 by

Thomas Bruun Managing Director, ETA-Danmark

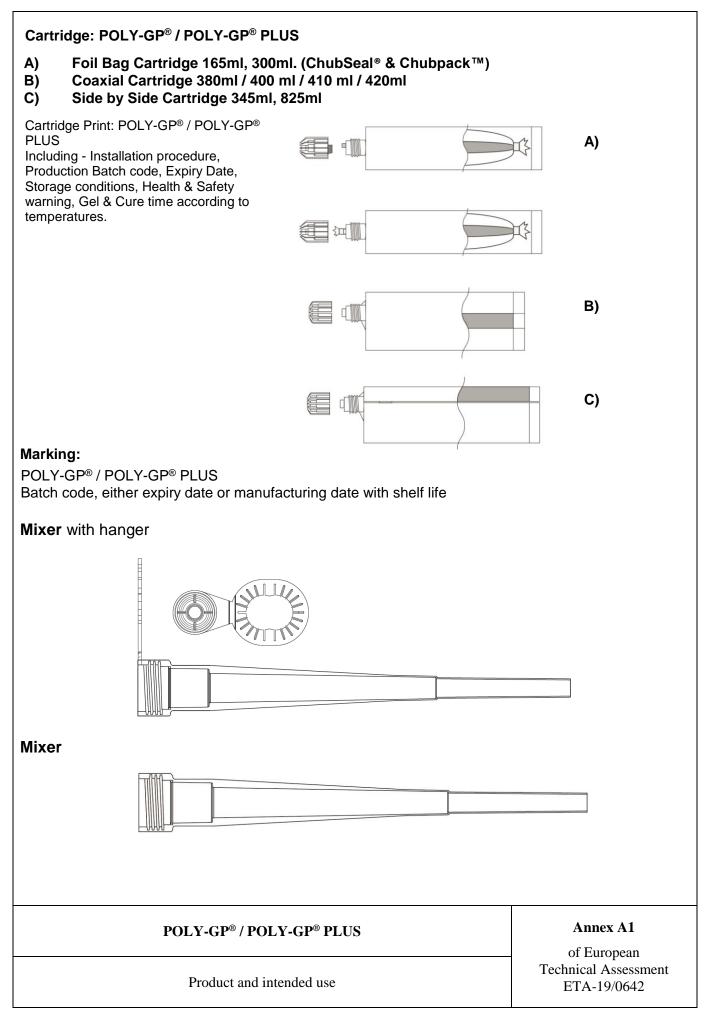

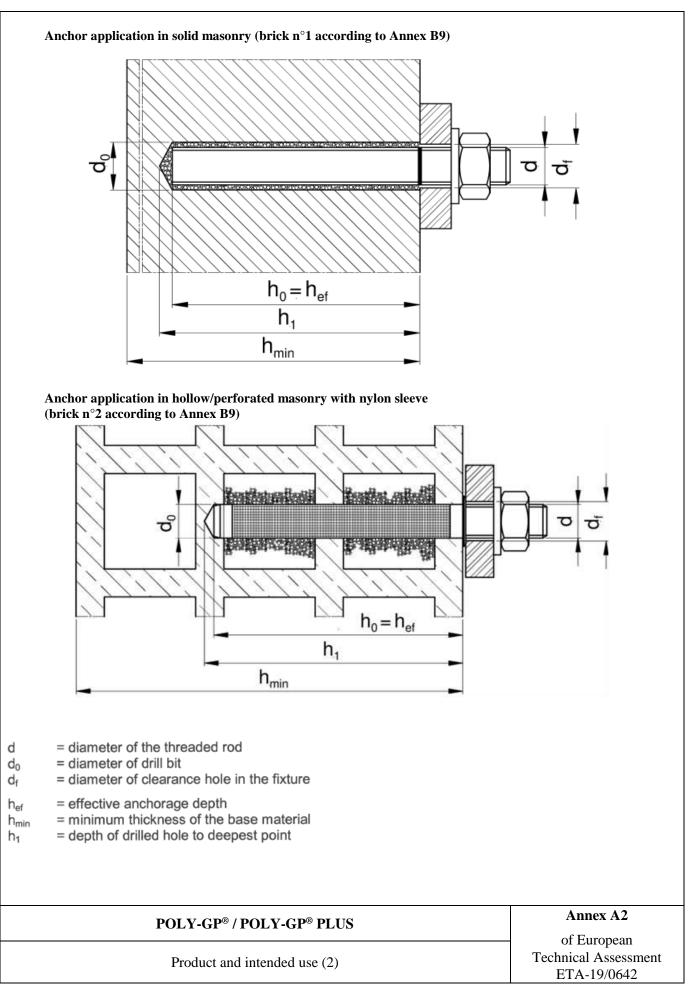

#### Injection Mortar: POLY-GP<sup>®</sup> / POLY-GP<sup>®</sup> PLUS – Resin System

Plastic sleeve for hollow/perforated masonry: nominal dimensions and material

Resin sleeves are the effective way to create a fixing where there is a hollow void, such as for perforated bricks and blocks, or a more porous material for example blockwork. Resin is injected to fill the volume of the sleeve and then forced through the fine perforations once the metal fixing rod is inserted. This distributes the resin material into the fixing cavity, forming a solid joint between the resin, the sleeve and the fixing.

2	
ſ	
U	

Nylon Perforated Sleeve – 16 x 85 Nominal Diameter 16mm Nominal Length 85mm

$\prod$	
U	

Nylon Perforated Sleeve – 12 x 80 Nominal Diameter 12mm Nominal Length 80mm

Table A1: Maximum working time and minimum curing time


Minimum base material temperature C°	Gel time (working time) In dry/wet conditions	Curing time in dry conditions	Curing time in wet conditions
$0^{\circ}C \leq T_{\text{base material}} < 10^{\circ}C$	20 min	90 min	180 min
$10^{\circ}C \leq T_{\text{base material}} < 20^{\circ}C$	9 min	60 min	120 min
$20^{\circ}C \leq T_{\text{base material}} < 30^{\circ}C$	5 min	30 min	60 min
$30^{\circ}C \leq T_{\text{base material}} \leq 40^{\circ}C$	3 min	20 min	40 min

The temperature of the bond material must be ≥ 20°C

#### POLY-GP® / POLY-GP® PLUS

Plastic sleeve and curing times

Annex A3



#### Table A2: Threaded rods materials

Designation	Material			
Threaded rods made of zi	nc coated steel			
	Strength class 4.6, 4.8, 5.6, 5.8, 8.8, 10.9 and 12.9 EN ISO 898-1			
Threaded rod M6 – M12	Steel galvanized $\geq$ 5µm EN ISO 4042			
	Hot dipped galvanized $\geq$ 45µm EN ISO 10684			
Washer ISO 7089	Steel galvanized EN ISO 4042; hot dipped galvanized EN ISO 10684			
	Strength class 8 EN ISO 898-2			
Nut EN ISO 4032	Steel galvanized $\geq$ 5µm EN ISO 4042			
	Hot dipped galvanized $\geq$ 45µm EN ISO 10684			
Threaded rods made of stainless steel				
Threaded rod M6 – M12	Strength class A2 or A4 – 50, A2 or A4-70 and A4-80 EN ISO 3506-1;			
Washer ISO 7089	Strength class A4-70 and A4-80 EN ISO 3506-1;			
Nut EN ISO 4032	Strength class A4-70 and A4-80 EN ISO 3506-1;			
Threaded rods made of hi	gh corrosion resistant steel			
Threaded and MC M12	Strength class 70 or 80.			
Threaded rod M6 – M12	High corrosion resistant steel 1.4529, 1.4565 EN 10088			
Washer ISO 7089	High corrosion resistant steel 1.4529, 1.4565 EN 10088			
Nut EN ISO 4032	Strength class 70 or 80 EN ISO 3506-2;			
1400 E14 150 4052	High corrosion resistant steel 1.4529, 1.4565 EN 10088			

Commercial standard threaded rods with:

material and mechanical properties according to Table A2;

confirmation of material and mechanical properties by inspection certificate 3.1 according to EN-10204:2004;
 morking of the threaded red with the ambedment depth

marking of the threaded rod with the embedment depth.

#### POLY-GP<sup>®</sup> / POLY-GP<sup>®</sup> PLUS

Annex A4

Materials

#### Use:

The anchors are intended to be used for anchorages for which requirements for mechanical resistance and stability and safety in use in the sense of the Basic Requirements 1 and 4 of Regulation 305/2011 (EU) shall be fulfilled and failure of anchorages made with these products would compromise the stability of the works, cause risk to human life and/or lead to considerable economic consequences.

#### Anchors subject to:

Static and quasi-static loads: M6 to M12

#### **Base materials:**

- Solid masonry (use category b) or hollow or perforated masonry (use category c) according to Annex B9. The mortar strength class of the masonry has to be M 2,5 according to EN 998-2:2010 at minimum

#### **Temperature range:**

The anchors may be used in the following temperature range:

- (a)  $-40^{\circ}$ C to  $+40^{\circ}$ C (max. short term temperature  $+40^{\circ}$ C and max. long term temperature  $+24^{\circ}$ C)
- (b)  $-40^{\circ}$ C to  $+80^{\circ}$ C (max. short term temperature  $+80^{\circ}$ C and max. long term temperature  $+50^{\circ}$ C)

#### Use conditions (Environmental conditions):

Threaded rods:

a) Carbon galvanized steel class 4.6, 4.8, 5.6, 5.8, 8.8, 10.9 or 12.9 according to EN ISO 898-1 for dry internal conditions.

b) Stainless steel A2 or A4-50, A2 or A4-70, A4-80 and HCR class 70 and 80 for structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition.

Nuts and washers:

Corresponding to anchor rod material above mentioned for the different environmental exposures.

#### Installation:

- Category w/w: installation into dry or wet environmental conditions.
- Perforation with a drilling machine

#### **Proposed design methods:**

- Static and quasi-static load: EOTA TR 054, Design Method A.

#### POLY-GP<sup>®</sup> / POLY-GP<sup>®</sup> PLUS

#### Annex B1

Intended use - Specification

Table B1 Installation data for solid masonry (brick n°1)*						
Size		<b>M6</b>	<b>M8</b>	M10	M12	
Nominal drilling diameter	d <sub>0</sub> [mm]	8	10	12	14	
Maximum diameter hole in the fixture	d <sub>fix</sub> [mm]	7	9	12	14	
Embedment depth	h <sub>ef</sub> [mm]	80	80	85	85	
Depth of the drilling hole	h <sub>1</sub> [mm]	$h_{ef} + 5 mm$				
Torque moment	T <sub>inst</sub> [Nm]	2	2	2	2	
Thislance to be fired	t <sub>fix,min</sub> [mm]	>0				
Thickness to be fixed	t <sub>fix,max</sub> [mm]	< 1500				
Minimum spacing	S <sub>min</sub> [mm]	240	240	255	255	
Minimum edge distance	C <sub>min</sub> [mm]	120	120	127.5	127.5	

\* Type of bricks are detailed in the Annex B9

#### Table B2: Installation data for hollow/perforated masonry (brick $n^\circ\,2)^*$

Size			M6	N	18	M10		M12
Plastic sleeve			12	x 80		16 x 85		85
Nominal drilling diameter	<b>d</b> <sub>0</sub>	[mm]	12	1	12	16		16
Maximum diameter hole in the fixture	$d_{\mathrm{fix}}$	[mm]	7		9	12		14
Embedment depth	$\mathbf{h}_{\mathrm{ef}}$	[mm]	80	8	30	85		85
Depth of the drilling hole	$h_1$	[mm]		1	$h_{ef} + 5$	5 mm		
Torque moment	$T_{\text{inst}}$	[Nm]	1.5	1	.5	1.5		1.5
Thickness to be fixed	t <sub>fix,min</sub>	[mm]	>0					
Thickness to be fixed	t <sub>fix,max</sub>	[mm]	< 1500					
	$S_{\min, \ }$	[mm]	250	250		250		250
Minimum spacing	$S_{min,\perp}$	[mm]	120	120		120		120
Minimum edge distance	C <sub>min</sub>	[mm]	100	100	1	100		100

\* Type of bricks are detailed in the Annex B9

#### POLY-GP<sup>®</sup> / POLY-GP<sup>®</sup> PLUS

Annex B2

Intended use - data

Aanua	al blower pump: no	ominal o	limensi	ons							
			— A — I — C	B							
1	90mm (240x190x30	0mm)	2	280mm (3	330x280x3	300mm)	40	00mm (42)	0x370x350	)mm)	
-(	( A ) : 240mm (overa	all)	-	-( A ) : 330	Omm (ove	rall)	-(	A): 420n	nm (overal	I)	
-(	( B ) : 190mm (Body	)	-	-(B):280	Omm (Boo	ly)	-(	B): 370n	nm (Body)		
-(	( C ) : 300mm (Tube	)	-	-( C ) : 30	0mm (Tub	e)	-(	C): 350n	nm (Tube)		
able	B3: Brush diameter		0	mm							
				Use in so	lid masonı	.y	Use in	Use in hollow/perforated masonry			
	of threaded rod	[	M6	M8	M10	M12	M6	M8	M10	M12	
do db	Nominal drill hole Brush diameter	[mm] [mm	8 10	10 10	12 13	14 13	16 18	16 18	16 18	16 18	
	P	OLY-G	P® / PO	DLY-GP®	PLUS				Ann	ex B3	
POLY-GP <sup>®</sup> / POLY-GP <sup>®</sup> PLUS Cleaning tools							,	of European Technical Assessment ETA-19/0642			

Image	Size Cartridge / Code	Туре
A	165 / 300ml 165 / 300 ml 10:1	Manual
	345 / 380 / 400 / 410 / 420ml 420 ml 10:1 345 ml 10:1	Manual
	165 / 300 / 345 / 380 / 400 / 410 / 420ml 165 / 300 ml 345ml 380 / 400 / 410 / 420 ml 7.4v Tool	Battery
	380 / 400 / 410 / 420 / 825ml 380 / 400 / 410 / 420 ml 825ml	Pneumatic

Annex B4

Tools for injection

Instructions for	or use		
Bore hole drill	ling		
		Drill hole to the required embedment depth with drilling mode using an appropriately sized carbic	
	-	ore setting an anchor, the bore hole must be free of dust and	l debris.
a) Manual air clo	eaning (MAC)		
	X 4	The manual pump may be used for blowing out Blow out at least 4 times from the back of the bo is free of noticeable dust.	
<b>* *</b> 0	X 4	Brush 4 times with the specified brush size (brus B3) by inserting the steel brush to the back of th extension) in a twisting motion and removing it. natural resistance as it enters the bore hole. If n must be replaced with the proper brush diameter	he hole (if needed with an The brush must produce not, the brush is too small and
	X 4	Blow out again with manual pump at least 4 time from noticeable dust.	es until return air stream is free
o) Compressed	l air cleaning	(CAC)	
6 Bar	X 2	Blow 2 times from the back of the hole (if neede the hole length with oil-free compressed air (min stream is free from noticeable dust.	
••••_0	X 2	Brush 2 times with the specified brush size (brus B3) by inserting the steel brush to the back of th extension) in a twisting motion and removing it. natural resistance as it enters the bore hole. If n must be replaced with the proper brush diamete	he hole (if needed with an The brush must produce hot, the brush is too small and
6 Bar	X 2	Blow out again with compressed air at least 2 tir free from noticeable dust.	nes until return air stream is
	BOL	Y-GP <sup>®</sup> / POLY-GP <sup>®</sup> PLUS	Annex B5

Procedure for solid masonry (1)

of European Technical Assessment

ETA-19/0642

Instructions for use	
↑ <sup>(III)</sup> ↑	Remove the threaded cap from the cartridge. Cut open the foil bag below the clip if necessary.
<b>↓</b>	Tightly attach the mixing nozzle. Do not modify the mixer in any way. Made sure the mixing element is inside the mixer. Use only the supplied mixer. For every working interruption longer than the recommended working time (Table A1) as well as for new cartridges, a new static-mixer shall be used.
	Insert the cartridge into the dispenser gun.
X	Discard the initial trigger pulls of adhesive. Depending on the size of the cartridge, an initial amount of adhesive mix must be discarded. Discard quantities are – 10cm for all cartridges

Instructions for use					
75%	Insert the nozzle to the bottom of the hole and inject the resin until the hole is filled 75%				
	Insert the anchor, slowly with a slight twisting motion into the hole. Remove excess resin and leave the fixing until minimum curing (loading) times has elapsed				

Annex B6

Procedure for solid masonry (2)

Instructions for u	ise	
Bore hole drilling	5	
		Drill hole to the required embedment depth with a hammer drill set in rotary drilling mode using an appropriately sized carbide drill bit.
Bore hole cleaning	Just before setting	g an anchor, the bore hole must be free of dust and debris.
a) Manual air clea	aning (MAC)	
	X 4	The manual pump may be used for blowing out bore holes Blow out at least 4 times from the back of the bore hole until return air stream is free of noticeable dust.
	X 4	Brush 4 times with the specified brush size (brush $\emptyset \ge$ bore hole $\emptyset$ , see Table) by inserting the steel brush to the back of the hole (if needed with an extension) in a twisting motion and removing it. The brush must produce natural resistance as it enters the bore hole. If not, the brush is too small and must be replaced with the proper brush diameter.
	X 4	Blow out again with manual pump at least 4 times until return air stream is free from noticeable dust.
b) Compressed ai	r cleaning (CA	AC)
S Bar	X 2	Blow 2 times from the back of the hole (if needed with a nozzle extension) over the hole length with oil-free compressed air (min. 6 bar at 6m <sup>3</sup> /h) until return air stream is free from noticeable dust.
O	X 2	Brush 2 times with the specified brush size (brush $\emptyset \ge$ bore hole $\emptyset$ , see Table B3) by inserting the steel brush to the back of the hole (if needed with an extension) in a twisting motion and removing it. The brush must produce natural resistance as it enters the bore hole. If not, the brush is too small and must be replaced with the proper brush diameter.
6 Bar	X 2	Blow out again with compressed air at least 2 times until return air stream is free from noticeable dust.

#### Table B5 - parameters: drilling, hole cleaning and installation in hollow brick work

#### POLY-GP<sup>®</sup> / POLY-GP<sup>®</sup> PLUS

Annex B7

Procedure for hollow/perforated masonry (1)

Instructions for use	
	Remove the threaded cap from the cartridge without cutting. Cut open the foil bag below the clip if necessary.(Chubpack cartridges).
<b>↓</b>	Tightly attach the mixing nozzle. Do not modify the mixer in any way. Made sure the mixing element is inside the mixer. Use only the supplied mixer with the adhesive. For every working interruption longer than the recommended working time (Table A1) as well as for new cartridges, a new static-mixer shall be used.
	Insert the cartridge into the dispenser. Press the release trigger to retract the plunger and insert the cartridge neatly into the cradle without any distortion.
×	Discard the initial trigger pulls 10cm of adhesive. Resin will flow from the cartridge as soon as dispensing is initiated.


Instructions for use	
	Introduce the sleeve of suitable dimension (see table B2) to the back of the hole so that the collar is level with the hole face. The cap may be opened to allow full nozzle insertion.
100%	Insert the nozzle to the end of the sleeve and inject the resin until the sleeve is 100% filled. Close the cap.
<b></b>	Insert the anchor, slowly with a slight twisting motion into the sleeve. Remove excess resin and leave the fixing until minimum curing (loading) times has elapsed

Procedure for hollow/perforated masonry (2)

#### Annex B8



**Brick n.1** Category b: Solid clay masonry: **Mattone pieno UNI (12.6.25)** Bulk density class ρ=1.6 kg/dm<sup>3</sup> Minimum compressive strength fb=18 MPa



**Brick n.2** Category c: Hollow masonry: **Doppio UNI (12.12.25)** Bulk density class ρ=0.9 kg/dm<sup>3</sup> Minimum compressive strength fb=6.0 MPa

#### POLY-GP<sup>®</sup> / POLY-GP<sup>®</sup> PLUS

Type and dimensions of the brick

Annex B9

Table C1:         Design method A, characteristic tension and shear load values						
ESSENTIAL CHARACTERISTICS			PERFORMANCE			
Installation parameters			M6	M8	M10	M12
d		[mm]	6	8	10	12
d <sub>0</sub> category b (solid masonry)		[mm]	8	10	12	14
d <sub>0</sub> category c (hollow or perforated maso	nry)	[mm]	12	12	16	16
Type of plastic sleeve for use in category	c		12x80	12x80	16x85	16x85
d <sub>fix</sub>		[mm]	7	9	12	14
h <sub>1</sub>		[mm]		h <sub>ef</sub> +	5 mm	
4	Min	[mm]		>	0	
$t_{\rm fix}$	Max	[mm]	≤ 1500 mm			
T <sub>inst</sub> category b (solid masonry)	T <sub>inst</sub> category b (solid masonry)		2	2	2	2
T <sub>inst</sub> category c (hollow or perforated masonry)		[Nm]	1.5	1.5	1.5	1.5
S <sub>min</sub> category b (solid masonry)	S <sub>min</sub> category b (solid masonry)		240	240	255	255
C <sub>min</sub> category b (solid masonry)		[mm]	120	120	127.5	127.5
S <sub>min</sub> category c (hollow masonry) S <sub>min,∥</sub>		[mm]	250	250	250	250
S <sub>min</sub> category c (hollow) S <sub>min,⊥</sub>		[mm]	120	120	120	120
C <sub>min</sub> category c (hollow masonry)		[mm]	100	100	100	100
* Resistance for tensile and shear load Temperature range -40°C/+40°C (T <sub>mlp</sub> = 24°C)			M6	M8	M10	M12
	NRk	[kN]	4	4	4	4
Brick n°1 (solid)	V <sub>Rk</sub>	[kN]	6	6	7	7
	N <sub>Rk</sub>	[kN]	2	2	2	2
Brick n°2 (hollow)	V <sub>Rk</sub>	[kN]	2	2	2	2
* Resistance for tensile and shear load Temperature range -40°C/+80°C (Tmlp = 50°C)			M6	M8	M10	M12
	N <sub>Rk</sub>	[kN]	3.5	3.5	3.5	3.5
Brick n°1 (solid)	V <sub>Rk</sub>	[kN]	6	6	7	7
<b>Derich</b> - ro <sup>0</sup> <b>2</b> (hallarra)	N <sub>Rk</sub>	[kN]	1.5	1.5	1.5	1.5
Brick n°2 (hollow)	V <sub>Rk</sub>	[kN]	2	2	2	2

Performance for static and quasi-static loads: Resistances

Table C2: Characteristic bending moments						
Size			M6	M8	M10	M12
Characteristic resistance with standard threaded rod grade 4.6	M <sub>Rk,s</sub>	[Nm]	6	15	30	52
Partial safety factor	$\gamma_{Ms}$	[-]		1,0	67	
Characteristic resistance with standard threaded rod grade 5.8	M <sub>Rk,s</sub>	[Nm]	8	19	37	66
Partial safety factor	$\gamma_{Ms}$	[-]		1,2	25	
Characteristic resistance with standard threaded rod grade 8.8	M <sub>Rk,s</sub>	[Nm]	12	30	60	105
Characteristic resistance with standard threaded rod grade 10.9	M <sub>Rk,s</sub>	[Nm]	15	37	75	131
Partial safety factor			1,25			
Characteristic resistance with standard threaded rod stainless steel A2 or A4-70 and HCR (class 70)	M <sub>Rk,s</sub>	[Nm]	11	26	52	92
Partial safety factor	$\gamma_{Ms}$	[-]		1,	56	
Characteristic resistance with standard threaded rod stainless steel A4-80 and HCR (class 80)	M <sub>Rk,s</sub>	[Nm]	12	30	60	105
Partial safety factor	$\gamma_{Ms}$	[-]		1,	33	

#### Table C3: Characteristic values for tension and shear load.

ESSENTIAL CHARACTERISTICS	PERFORMANCE					
* Resistance for tensile and shear load Temperature range -40°C/+40°C ( $T_{mlp}$ = -40°C/+80°C ( $T_{mlp}$ = 50°C)	M6	M8	M10	M12		
$\gamma_{Mm}$ [-] Category w/w		2	2,50			
Devials nº 1	S <sub>cr,N</sub>	[mm]	240	240	255	255
Brick n°1	C <sub>cr,N</sub>	[mm]	120	120	127,5	127,5
	$S_{cr,N, \ }$	[mm]	250	250	250	250
Brick n°2	$S_{cr,N} \perp$	[mm]	120	120	120	120
	C <sub>cr,N</sub>	[mm]	100	100	100	100
β coefficient for in situ test (ETAG 029 Annex B) Temperature range: -40°C/+40°C			M6	M8	M10	M12
Brick Nº 1 - Solid brick	β	[-]	0,90	0,87	0,87	0,76
Brick Nº 2 - Hollow/perforated brick	β	[-]	0,90	0,87	0,87	0,76
β coefficient for in situ test (ETAG 029 Annex B) Temperature range: -40°C/+80°C			M6	M8	M10	M12
Brick Nº 1 - Solid brick	β	[-]	0,73	0,70	0,70	0,62
Brick Nº 2 - Hollow/perforated brick	β	[-]	0,73	0,70	0,70	0,62

#### POLY-GP<sup>®</sup> / POLY-GP<sup>®</sup> PLUS

Performance for static, quasi-static: Displacements

Displacement under service load	- Tensile load				
Temperature range -40°C/+40°C	$C(T_{mlp} = 24^{\circ}C)$				
Brick n°1 – Solid brick		M6	M8	M10	M12
Admissible service load in tensile	F [kN]		1	,14	÷
Diantecoment	$\delta_{N0}$ [mm]	0,09	0,09	0,04	0,04
Displacement	$\delta_{N^{\infty}}$ [mm]	0,18	0,18	0,07	0,09
Brick n°2 – Hollow/perforated b	M6	M8	M10	M12	
Brick if 2 – Honow/perforated b		With sleeve	With sleeve	With sleeve	With sleeve
Admissible service load in tensile	F [kN]			,57	1
Displacement	$\delta_{N0}$ [mm]	0,10	0,17	0,17	0,14
	$\delta_{N^{\infty}}$ [mm]	0,21	0,35	0,35	0,28
Temperature range -40°C/+80°C	$(\text{Tmlp} = 50^{\circ}\text{C})$				
Brick n°1 – Solid brick		M6	M8	M10	M12
Admissible service load in tensile	F [kN]		1	,00	-
Displacement	$\delta_{N0}$ [mm]	0,08	0,08	0,03	0,04
Displacement	$\delta_{N^{\infty}}$ [mm]	0,16	0,16	0,06	0,07
Brick n°2 – Hollow/perforated b	rick	M6	M8	M10	M12
		With sleeve With sleeve With sleeve			With sleeve
Admissible service load in tensile	F [kN]			,43	
Displacement	$\delta_{N0}$ [mm]	0,08	0,13	0,13	0,10
-	$\delta_{N^{\infty}}$ [mm]	0,16	0,26	0,26	0,21
Displacement under service load					
Temperature range -40°C/+40°C	$L(T_{mlp} = 24^{\circ}C)$	r			
Brick n°1 – Solid brick		M6	M8	M10	M12
Admissible service load in shear	F [kN]	,	71	2,0	
Displacement	$\delta_{V0}$ [mm]	0,97	0,97	1,03	0,58
Displacement	$\delta_{V^{\infty}}$ [mm]	1,45	1,45	1,55	0,87
Brick n°2 – Hollow/perforated b	rick	M6	M8	M10	M12
		With sleeve	With sleeve	With sleeve	With sleeve
Admissible service load in shear	$\begin{array}{c} F  [kN] \\ \delta_{V0}  [mm] \end{array}$	0,74	0,57 0,84	0,84	1,86 1,52
Displacement		· · · · ·		,	
T 400 C/- 900 C	$\delta_{V\infty}$ [mm]	1,11	1,26	1,26	2,29
Temperature range -40°C/+80°C	$(1 \text{ mlp} = 50^{\circ} \text{C})$	М	MO	N/10	N/10
Brick n°1 – Solid brick		M6	M8	M10	M12
Admissible service load in shear F [kN]		1,71		2,00	
Admissible service foud in silear		0,97	0,97	1,03	0,58
	$\delta_{V0}$ [mm]	i			
	$\begin{array}{c} \delta_{V0} & [mm] \\ \\ \delta_{V^{\infty}} & [mm] \end{array}$	1,45	1,45	1,55	0,87
Displacement	$\delta_{V\infty}$ [mm]	M6	M8	M10	M12
Displacement Brick n°2 – Hollow/perforated br	δ <sub>V∞</sub> [mm] rick		M8 With sleeve		M12 With sleeve
Displacement Brick n°2 – Hollow/perforated by Admissible service load in shear	$\delta_{V\infty}$ [mm]	M6	M8	M10	M12

Performance for static, quasi-static and seismic loads: Displacements

#### Table C4: Reaction to fire.

ESSENTIAL CHARACTERISTICS	PERFORMANCE
Reaction to fire	In the final application, the thickness of the mortar layer is about 1 to 2 mm and most of the mortar is material classified class A1 according to EC Decision 96/603/EC. Therefore, it may be assumed that the bonding material (synthetic mortar or a mixture of synthetic mortar and cementitious mortar) in connection with the metal anchor in the end use application do not make any contribution to fire growth or to the fully developed fire and they have no influence to the smoke hazard.

#### Table C5: Resistance to fire.

ESSENTIAL CHARACTERISTICS	PERFORMANCE
Resistance to fire	NPA

#### POLY-GP<sup>®</sup> / POLY-GP<sup>®</sup> PLUS

Performance for static, quasi-static and seismic loads: Fire reaction and resistance